



## Certificate of Analysis


**Client:**


US Gains Inc.,  
7308 18<sup>th</sup> Avenue,  
Brooklyn, NY 11204

**Sample Collected By: Client**

Product Name	MK677	Product Lot Number	1
Report Date	11/20/20	Laboratory Number	20111376


Description	Method	Specification	Results
Identification	H-NMR	Conforms	Conforms
MK677	HPLC	98%	100.9%

Collin Thomas   
Laboratory Manager

11/20/2020   
Date

The result(s) stated in this report is only for the sample submitted. This report may not be reproduced in whole or in part, nor may any reference be made to the work, the result, or the company in any news release, public announcements or advertising without our prior written consent.

**<sup>1</sup>H NMR of MK667**  
 in DMSO  
 Lot #20111376  
 Colmaric Analytical  
 400 MHz  
 11-11-20

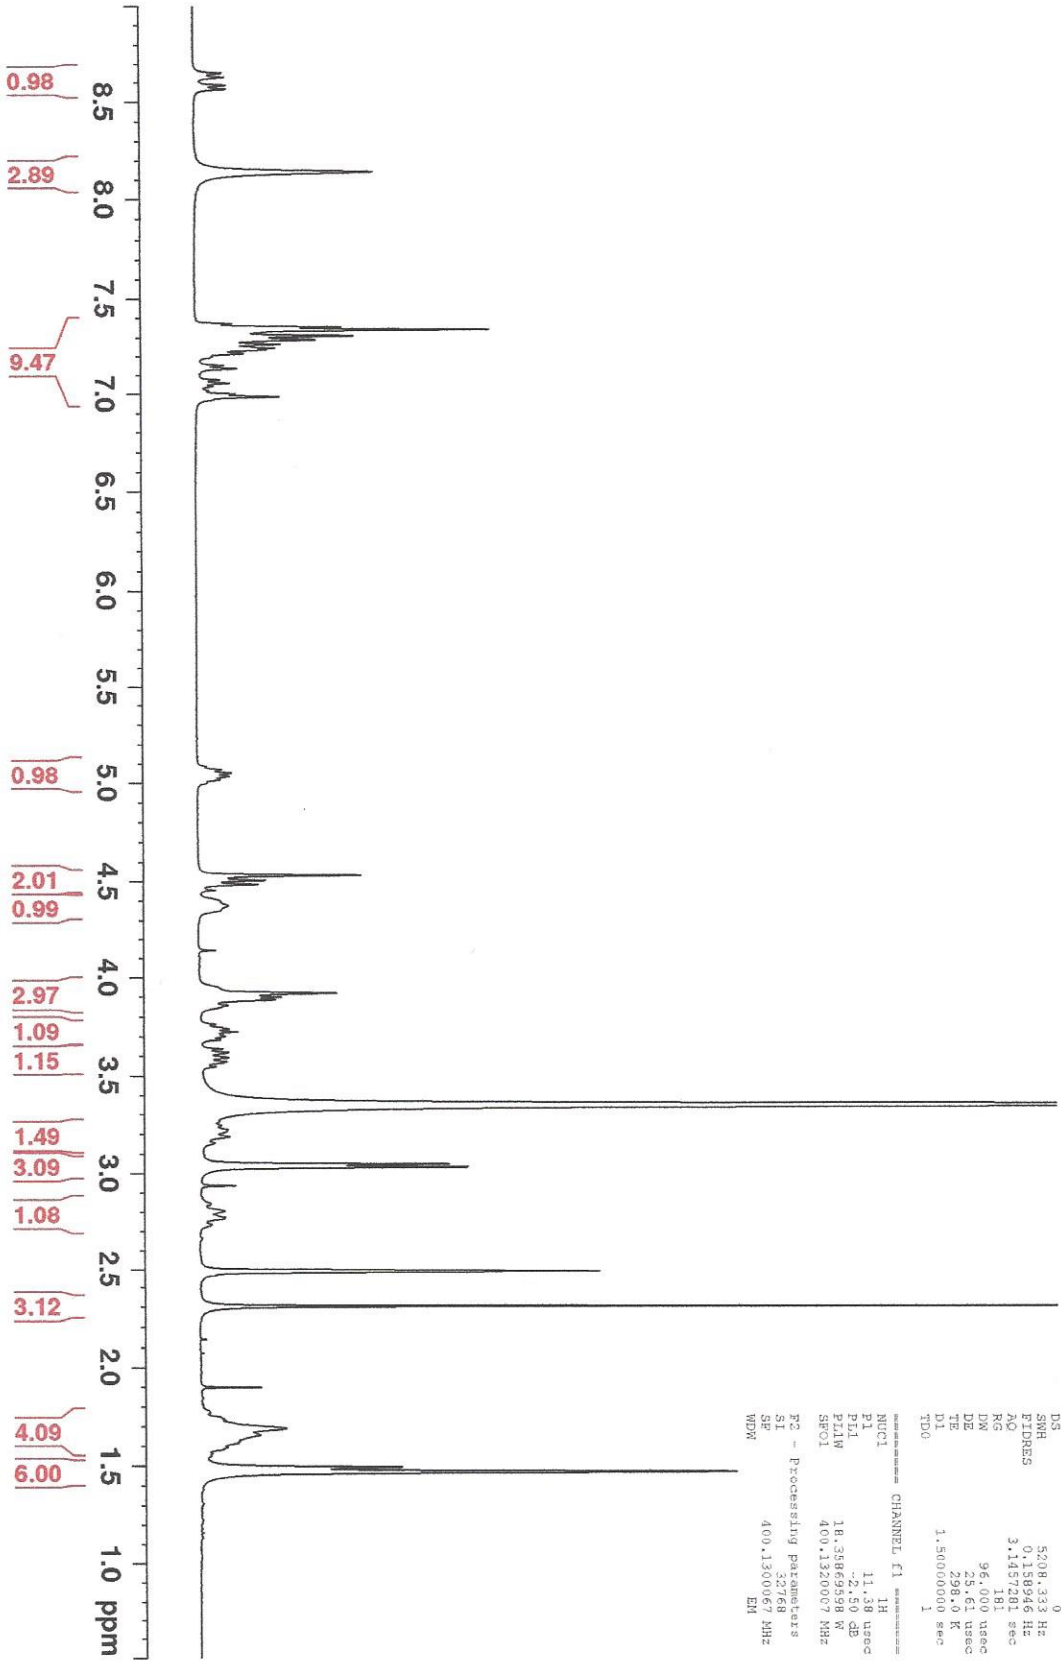

Current Data Parameters  
 NAME Nov11-2020-colmaric  
 EXPNO 2  
 PROCNO 1  
 F2 - Acquisition Parameters  
 Date\_ 20201111  
 Time 11:41  
 INSTRUM spect  
 PROBHD 5 mm PABBO-BB-  
 PULPROG zg30  
 TD 32768  
 SOLVENT DMSO  
 NS 32  
 DS 0  
 SWH 5208.333 Hz  
 FIDRES 0.158946 Hz  
 AQ 3.1457241 sec  
 RG 655  
 KS 1  
 LK 0  
 DE 96.000 usec  
 TE 298.0 K  
 D1 1.50000000 sec  
 TDO 1

CHANNEL F1  
 NUC1 <sup>1</sup>H  
 P1 11.38 usec  
 PL 0.00 dB  
 F2 400.130067 MHz  
 SFO1 400.1320007 MHz  
 PC - Processing parameters  
 SI 32768  
 SF 400.130067 MHz  
 WDW EM